

#### **DECLARATION OF PERFORMANCE**



DoP: 0161

for fischer Injection system T-BOND PRO.1 or Injection system FIS C700 HP PRO.1 (Metal injection anchors for use in masonry) – EN

1. Unique identification code of the product-type: DoP: 0161

2. Intended use/es: Anchorages in masonry for which requirements for mechanical resistance and stability and safety in use shall be fulfilled. They are for fixing and/or supporting structural elements (which contribute to the stability of the works) or heavy units, see appendix, especially Annexes B 1 to B 10

3. Manufacturer: fischerwerke GmbH & Co. KG, Klaus-Fischer-Straße 1, 72178 Waldachtal, Germany

4. Authorised representative: --

5. System/s of AVCP: 1

6. European Assessment Document: ETAG 029; 2013-04

European Technical Assessment: ETA-17/0429; 2017-10-27

Technical Assessment Body: DIBt

Notified body/ies: 1343 - MPA Darmstadt

7. Declared performance/s:

Mechanical resistance and stability (BWR 1), Safety and accessibility (BWR 4)

Characteristic resistance for tension and shear loads: See appendix, especially Annexes C 1 to C 6

- Characteristic resistance for bending moments: See appendix, especially Annex C 7
- Displacements under shear and tension loads: See appendix, especially Annex C 7
- Reduction Factor for job site tests (ß-Factor): See appendix, especially Annex C 8
- Edge distances and spacing: See appendix, especially Annexes C 9 to C 10

#### Safety in case of fire (BWR 2)

Reaction to fire: Anchorages satisfy requirements for Class A 1

• Resistance to fire: NPD

8. Appropriate Technical Documentation and/or Specific Technical Documentation: ---

The performance of the product identified above is in conformity with the set of declared performance/s. This declaration of performance is issued, in accordance with Regulation (EU) No 305/2011, under the sole responsibility of the manufacturer identified above.

Signed for and on behalf of the manufacturer by:

1.V. A. Dun

Andreas Bucher, Dipl.-Ing.

Wolfgang Hengesbach, Dipl.-Ing., Dipl.-Wirtsch.-Ing.

i.V. W. Mylal

Tumlingen, 2017-11-06

- This DoP has been prepared in different languages. In case there is a dispute on the interpretation the english version shall always prevail.

- The Appendix includes voluntary and complementary information in English language exceeding the (language-neutrally specified) legal requirements.

#### **Specific Part**

#### 1 Technical description of the product

The fischer injection system T-BOND PRO.1 or FIS C700 HP PRO.1 for masonry is a bonded anchor (injection type) consisting of a mortar cartridge with fischer injection mortar T-BOND PRO.1 or FIS C700 HP PRO.1, a perforated sieve sleeve and an anchor rod with hexagon nut and washer or an internal threaded rod in the range of M6 to M16. The steel elements are made of zinc coated steel, stainless steel or high corrosion resistant steel.

The anchor rod is placed into a drilled hole filled with injection mortar and is anchored via the bond between steel element, injection mortar and masonry and mechanical interlock.

The product description is given in Annex A.

# 2 Specification of the intended use in accordance with the applicable European Assessment Document

The performances given in Section 3 are only valid if the anchor is used in compliance with the specifications and conditions given in Annex B.

The verifications and assessment methods on which this European Technical Assessment is based lead to the assumption of a working life of the anchor of at least 50 years. The indications given on the working life cannot be interpreted as a guarantee given by the producer, but are to be regarded only as a means for choosing the right products in relation to the expected economically reasonable working life of the works.

#### 3 Performance of the product and references to the methods used for its assessment

#### 3.1 Mechanical resistance and stability (BWR 1)

Essential characteristic	Performance
Characteristic resistance for tension and shear loads	See Annex C 1 – C 6
Characteristic bending moments	See Annex C 7
Displacements under shear and tension loads	See Annex C 7
Reduction Factor for job site tests (β-Factor)	See Annex C 8
Edge distances and spacing	See Annex C 9 – C 10

### 3.2 Safety in case of fire (BWR 2)

Essential characteristic	Performance
Reaction to fire	Anchorages satisfy requirements for Class A1
Resistance to fire	No performance assessed

#### 3.3 Hygiene, health and the environment (BWR 3)

Regarding dangerous substances there may be requirements (e.g. transposed European legislation and national laws, regulations and administrative provisions) applicable to the products falling within the scope of this European Technical Assessment. In order to meet the provisions of Regulation (EU) No 305/2011, these requirements need also to be complied with, when and where they apply.

#### 3.4 Safety and accessibility in use (BWR 4)

The essential characteristics regarding Safety in use are included under the Basic Works Requirement Mechanical resistance and stability.


4 Assessment and verification of constancy of performance (AVCP) system applied, with reference to its legal base

In accordance with guideline for European technical approval ETAG 029, April 2013 used as European Assessment Document (EAD) according to Article 66 Paragraph 3 of Regulation (EU) No 305/2011 the applicable European legal act is: [97/177/EC].

The system to be applied is: 1

### Installation conditions part 1


Threaded rods with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

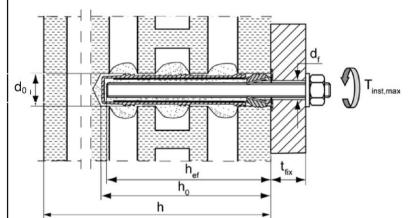

### Pre-positioned installation

FIS H 12x50 K FIS H 12x85 K FIS H 16x85 K FIS H 16x130 K FIS H 20x85 K FIS H 20x130 K FIS H 20x200 K

Internal threaded anchors FIS E with perforated sleeve FIS H K; Installation in perforated and solid brick masonry

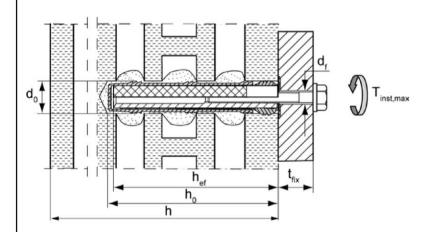

### Pre-positioned installation

FIS H 16x85 K – FIS E 11x85 M6 and M8 FIS H 20x85 K – FIS E 15x85 M10 and M12

h<sub>ef</sub> = effective anchorage depth

 $\begin{array}{ll} h_0 = & \text{depth of drill hole} \\ t_{\text{fix}} = & \text{thickness of fixture} \\ h = & \text{thickness of masonry} \end{array}$ 

d<sub>0</sub>= nominal drill bit diameter

d<sub>f</sub>= diameter of clearance hole in the fixture

T<sub>inst,max</sub> = maximum torque moment

### fischer Injectionsystem T-BOND PRO.1 – FIS C700 HP PRO.1


#### **Product description**


Installation condition, part 1: in perforated and solid brick masonry

Annex A 1


### Installation conditions part 2

Threaded rods without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete

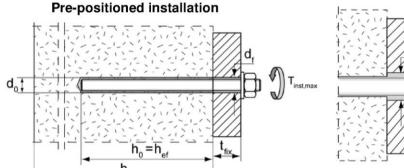



Internal threaded anchors FIS E without perforated sleeve FIS H K; Installation in solid brick masonry and autoclaved aerated concrete

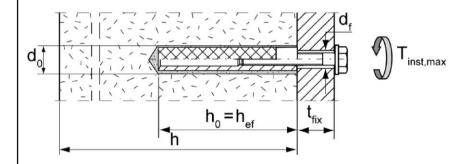

#### Pre-positioned installation

FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12

h<sub>ef</sub> = effective anchorage depth

 $h_0 =$  depth of drill hole  $t_{fix} =$  thickness of fixture

h = thickness of masonry

d<sub>0</sub>= nominal drill bit diameter

d<sub>f</sub>= diameter of clearance hole in the fixture


T<sub>inst,max</sub> = maximum torque moment

fischer	Injection system	T-ROND	PRO 1 -	FIS (	C700 H	P PRO 1
Hachel	IIIIECHOH SVSIEH	I I-DOIND	FNU.I-	110	G/UU 11	F FNO. I

#### **Product description**

Installation condition, part 2: in solid brick masonry and autoclaved aerated concrete

Annex A 2

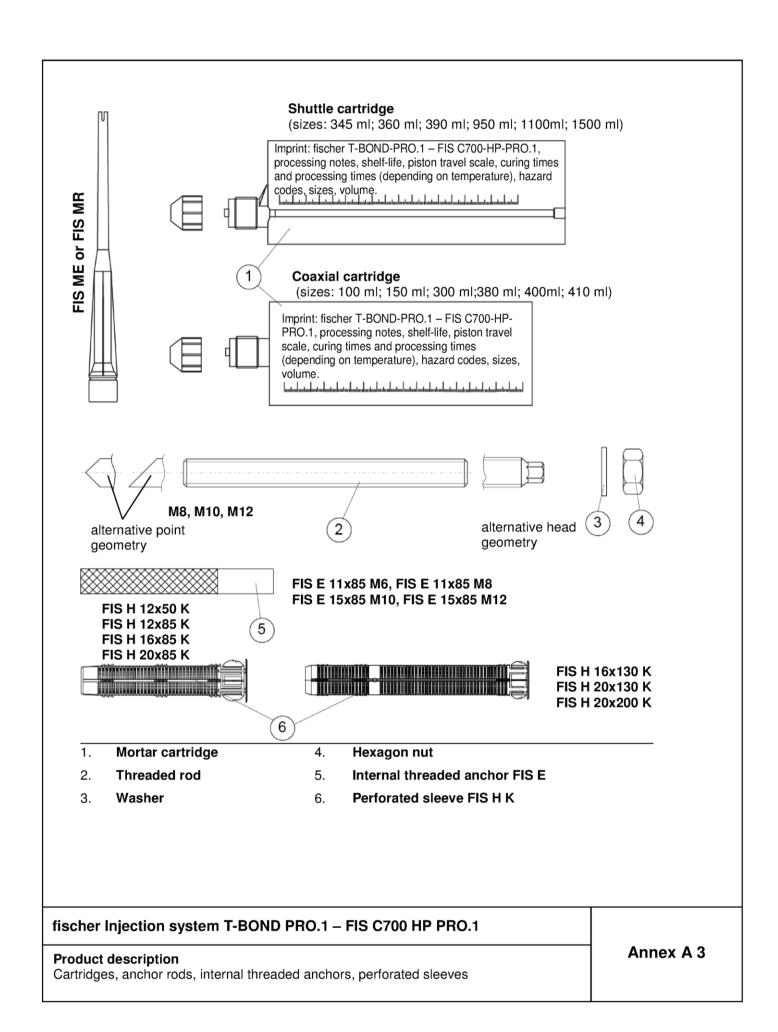

## Table A1: Materials

Part	Designation	Material						
1	Mortar cartridge	r	mortar, hardener; filler					
		Steel, zinc plated	Stainless steel A4	High corrosion- resistant steel C				
	Threaded rod	Property class 5.8 or 8.8; ISO 898-1:2013	Property class 50, 70 or 80	Property class 50 or 80 EN ISO 3506-1:2009				
		zinc plated ≥ 5µm, EN ISO 4042:1999	EN ISO 3506-1:2009 1.4401; 1.4404;	or property class 70 with f <sub>vk</sub> = 560 N/mm <sup>2</sup>				
2		A2K or hot-dip galvanised	1.4578; 1.4571;	1.4565; 1.4529				
		EN ISO 10684:2004	1.4439; 1.4362;	EN 10088-1:2014				
		$f_{uk} \le 1000 \text{ N/mm}^2$	1.4062	f <sub>uk</sub> ≤ 1000 N/mm <sup>2</sup>				
		$A_5 > 8\%$	EN 10088-1:2014	$A_5 > 8\%$				
			$f_{uk} \le 1000 \text{ N/mm}^2$					
	100		A <sub>5</sub> > 8%	4 4505 4 4500				
	Washer	zinc plated ≥ 5µm,	1.4401; 1.4404;	1.4565;1.4529				
3	ISO 7089:2000	EN ISO 4042:1999 A2K	1.4578;1.4571;	EN 10088-1:2014				
		or hot-dip galvanised ISO 10684:2004	1.4439; 1.4362 EN 10088-1:2014					
	Hexagon nut	Property class 5 or 8;	Property class 50, 70	Property class 50, 70 or				
	l lexagon nut	EN ISO 898-2:2012	or 80	80				
		zinc plated ≥ 5µm,	EN ISO 3506-1:2009	EN ISO 3506-1:2009				
4		ISO 4042:1999 A2K	1.4401; 1.4404;	1.4565; 1.4529				
		or hot-dip galvanised	1.4578; 1.4571;	EN 10088-1:2014				
		ISO 10684:2004	1.4439; 1.4362					
			EN 10088-1:2014					
	Internal threaded anchor	Property class 5.8;	Property class 70	Property class 70				
	FIS E	EN 10277-1:2008-06	EN ISO 3506-1:2009	EN ISO 3506-1:2009				
5		zinc plated ≥ 5µm,	1.4401; 1.4404;	1.4565; 1.4529				
		EN ISO 4042:1999 A2K	1.4578; 1.4571;	EN 10088-1:2014				
			1.4439; 1.4362					
			EN 10088-1:2014					
	Screw or threaded rod for	Property class 5.8 or 8.8;	Property class 70	Property class 70				
	internal threaded anchor	EN ISO 898-1:2013	EN ISO 3506-1:2009	EN ISO 3506-1:2009				
	FIS E	zinc plated ≥ 5μm, ISO 4042:1999 A2K	1.4401; 1.4404; 1.4578; 1.4571;	1.4565; 1.4529 EN 10088-1:2014				
		130 4042.1999 AZN	1.4439; 1.4362	EN 10000-1.2014				
			EN 10088-1:2014					
6	Perforated sleeve FIS H K		PP / PE	1				

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Product description Materials	Annex A 4

### Specifications of intended use

### Anchorages subject to:

Static and quasi-static loads

#### **Base materials:**

- Solid brick masonry (Use category b) and autoclaved aerated concrete (Use category d), acc. to Annex B8.
   Note: The characteristic resistance is also valid for larger brick sizes and higher compressive strength of the masonry unit.
- Hollow brick masonry (use category c), according to Annex B8
- Mortar strength class of the masonry M2,5 at minimum according to EN 998-2:2010
- For other bricks in solid masonry, hollow or perforated masonry and autoclaved aerated concrete, the characteristic resistance of the anchor may be determined by job site tests according to ETAG 029, Annex B under consideration of the β-factor according to Annex C6, Table C4

#### **Temperature Range:**

From - 40°C to +80°C (max. short term temperature +80°C and max. long term temperature +50°C)

#### Use conditions (Environmental conditions):

- · Dry and wet structure (regarding injection mortar)
- Structures subject to dry internal conditions exist
   (zinc coated steel, stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure including industrial and marine environment or exposure
  to permanently damp internal condition, if no particular aggressive conditions exist
  (stainless steel or high corrosion resistant steel)
- Structures subject to external atmospheric exposure and to permanently damp internal condition, if other particular aggressive conditions exist (high corrosion resistant steel)
  - Note: Particular aggressive conditions are e.g. permanent, alternating immersion in seawater or the splash zone of seawater, chloride atmosphere of indoor swimming pools or atmosphere with extreme chemical pollution (e.g. in desulphurization plants or road tunnels where de-icing materials are used)

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Specifications	Annex B 1

### Specifications of intended use

#### Design:

• The anchorages have to be designed in accordance with the ETAG 029, Annex C, Design method A under the responsibility of an engineer experienced in anchorages and masonry work

Applies to all bricks, if no other values are specified:

$$N_{Rk} = N_{Rk,s} = N_{Rk,p} = N_{Rk,b} = N_{Rk,pb}$$

$$V_{Rk} = V_{Rk,s} = V_{Rk,b} = V_{Rk,c} = V_{Rk,pb}$$

Verifiable calculation notes and drawings have to be prepared taking account the relevant masonry in the
region of the anchorage, the loads to be transmitted and their transmission to the supports of the structure. The
position of the anchor is indicated on the design drawings

#### Installation:


- Category d/d: -Installation and use in dry structures
- · Category w/w: -Installation and use in dry and wet structures
- · Hole drilling by hammer drill mode
- In case of aborted hole: The hole shall be filled with mortar
- Bridging of unbearing layer (e.g. plaster) see Annex B 4 (Table B1.3)
- Anchor installation carried out by appropriately qualified personnel and under the supervision of the person responsible for technical matters of the site
- Fastening screws or threaded rods (including nut and washer) must comply with the appropriate material and property class of the fischer internal threaded anchor FIS E
- minimum curing time see Annex B5. Table B3
- Commercial standard threaded rods, washers and hexagon nuts may also be used if the following requirements are fulfilled:

Material dimensions and mechanical properties of the metal parts according to the specifications are given in Annex A4, Table A1

Conformation of material and mechanical properties of the metal parts by inspection certificate 3.1 according to EN 10204:2004, the documents shall be stored

Marking of the threaded rod with the envisage embedment depth. This may be done by the manufacturer of the rod or by a person on job site

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Specifications	Annex B 2

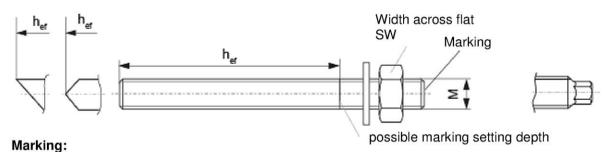

Property class (p.c.) 8.8, Stainless steel A4, p.c. 80 or high corrosion-resistant steel C, p.c. 80: • Stainless steel A4, property class 50 and high corrosion-resistant steel C, property class 50: ••

Table B1.1: Installation parameters for threaded rod without perforated sleeve

Size				M8	M10	M12
Nominal drill hole diamet	ter	$d_{nom}=d_0$	[mm]	10	12	14
Width across flat		SW	[mm]	13	17	19
Effective anchorage dep	th <sup>1)</sup>	h <sub>ef,min</sub>	[mm]	50		
Depth of drill hole $h_0 = h_0$	ef	h <sub>ef,max</sub>	[mm]	] h-30 and ≤ 200 mm		
Effective anchorage dep	h <sub>ef,min</sub>	mm]	100			
Effective affortage dep	h <sub>ef,max</sub>	[mm]		120		
Maximum torque momer	nt	$T_{inst,max}$	[Nm]		10	
Max. torque moment for	autoclaved aerated concrete	$T_{inst,max}$	[Nm]	1 2		
Diameter of clearance	Pre-position anchorage	d <sub>f</sub> ≤	[mm]	9	12	14
hole in the fixture	Push through anchorage	d <sub>f</sub> ≤	[mm]	11	14	16

 $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.

### fischer internal threaded anchor FIS E

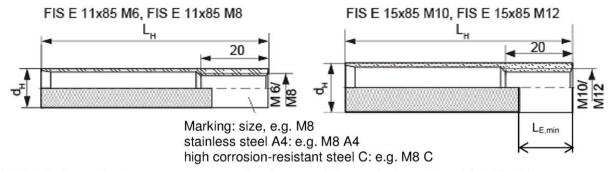


Table B1.2: Installation parameters for internal threaded anchor FIS E without perforated sleeve

Size FIS E			11x85 M6	11x85 M8	15x85 M10	15x85 M12
diameter of internal threaded anchor	$d_H$	[mm]	1	1	1	5
Nominal drill hole diameter	$d_{nom}=d_0$	[mm]	1	4	1	8
Depth of drill hole	ho	[mm]	85			
Effective anchorage depth	$L_{H}=h_{ef}$	[mm]	85			
Maximum torque moment	T <sub>inst, max</sub>	[Nm]	4		10	
Max. torque moment for autoclaved aerated concrete	T <sub>inst, max</sub>	[Nm]	1		2	
Diameter of clearance hole in the fixture	d <sub>f</sub> ≤	[mm]	7	9	12	14
Screw-in depth	$L_{E,min}$	[mm]	6	8	10	12

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Installation parameters, part 1	Annex B 3

## Perforated sleeves FIS H 12x50; 12x85; 16x85; 16x130; 20x85; 20x130; 20x200K

Marking:size D<sub>Sleeve</sub> x L<sub>Sleeve</sub> e.g. 16x85






Table B1.3: Installation parameters (threaded rod and internal threaded anchor with perforated sleeve; only pre-positioned anchorage)

Size FIS HK			12x50	12x85	16x85	16x130 <sup>2)</sup>	20x85	20x130 <sup>2)</sup>	20x200 <sup>2)</sup>
Nominal drill hole diameter ( $d_0 = D_{Sleeve}$ )	d <sub>nom</sub> =d <sub>0</sub>	[mm]	1	2	1	6		20	
Depth of drill hole	$h_0$	[mm]	55	90	90	135	90	135	205
Effective anchorage depth <sup>1)</sup>	h <sub>ef,min</sub>	[mm]	50	85	85	110	85	110	180
	$h_{\text{ef,max}}$	[mm]	50	85	85	130	85	130	200
Size of threaded rod		[-]	M8		M8, M10		M12		
Size of internal threaded anchor		[-]			11x85		15x85		
Maximum torque moment threaded rod and internal threaded anchor	$T_{inst,max}$	[mm]				2			

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Installation parameters, part 2	Annex B 4

 $<sup>^{1)}</sup>$   $h_{ef,min} \le h_{ef} \le h_{ef,max}$  is possible.  $^{2)}$  Bridging of unbearing layer (e.g. plaster) possible

## Cleaning brush BS (Steel brush)



Only for solid bricks and autoclaved aerated concrete

Parameters of steel brush Table B2:

Drill hole diameter	d <sub>0</sub>	[mm]	10	12	14	16	18	20
Brush diameter	d <sub>b,nom</sub>	[mm]	11	14	16	20	20	25

**Table B3:** Maximum processing time of the mortar and minimum curing time (During the curing time of the mortar the masonry temperature may not fall below the listed minimum

temperature).

			Minimum curing time 1) t <sub>cure</sub>
Temperature at anchoring base [ °C ]		base	T-BOND PRO.1FIS C700 HP PRO.1 <sup>2)</sup>
>-5	to	±Ο	24 h
>±0	to	+5	3 h
>+5	to	+10	90 min
>+10	to	+20	60 min
>+20	to	+30	45 min
>+30	to	+40	35 min

System-	Maximum processing time twork				
temperature (mortar) [ °C ]	T-BOND PRO.1FIS C700 HP PRO.1 <sup>2)</sup>				
±0					
+5	13 min				
+10	9 min				
+20	5 min				
+30	4 min				
+40	2 min				

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use	Annex B 5
Steel brush	
Processing times and curing times	1

<sup>&</sup>lt;sup>1)</sup> For wet bricks the curing time must be doubled · <sup>2)</sup> Minimum cartridge temperature +5°C

#### Installation instructions Part 1

Installation and Preparing the cartridge in solid brick and autoclaved aerated concrete (without perforated sleeve)

Drill the hole. Depth of drill hole  $h_0$  and drill hole diameter  $d_0$  see Table **B1.1** or **B1.2** 

2








Blow out the drill hole two times. Brush the drill hole two times (see Table B2) and blow out two times again

3




Remove the sealing cap



Screw on the static mixer (the spiral in the static mixer must be clearly visible)

4




Place the cartridge into a suitable dispenser.




Press out approximately 10 cm of material until the mortar is permanently grey in colour. Mortar which is not grey in colour will not cure and must be disposed off.

5




Fill approximately 2/3 of the drill hole with mortar Always begin from the bottom of the hole to eliminate voids<sup>1)</sup>.



For push through installation (not FIS E) fill the annular gap also with mortar.

6




Only use clean and oil-free anchor elements. Mark the threaded rod for setting depth. Press the threaded rod or internal threaded anchor FIS E down to the bottom of the hole, turning it slightly by hand while doing. After inserting the anchor element, excess mortar must emerge around the anchor element.

7



Do not touch. Minimum curing time t<sub>cure</sub> see Table **B3** 



Mounting the fixture T<sub>inst,max</sub> see Table **B1.1** or **B1.2** 

### fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1

#### Intended Use


Installation instructions part 1 in solid brick and autoclaved aerated concrete

Annex B 6

<sup>1)</sup> For the exact quantity of mortar see manufacturer's specification.

#### **Installation instructions Part 2**

Installation in perforated or solid brick with perforated sleeve (pre-positioned anchorage)

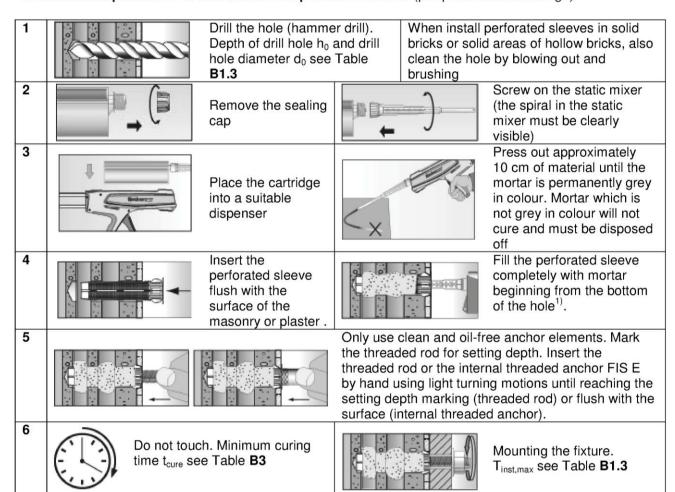

<sup>1)</sup> For the exact quantity of mortar see manufacturer's specification.

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Installation instructions part 2 in hollow brick masonry	Annex B 7

Brick No. 1	~-3		Brick No. 8	~~	
Solid brick Mz	115		Perforated brick	579	
according to	2		HLz filled with mineral wool		
EN 771-1 ρ ≥ 1,8 [kg/dm <sup>3</sup> ]			according to		4. A. S.
fb ≥ 10 or 20	340		EN 771-1		7 10 132 55
[N/mm²]			ρ ≥ 0,6 [kg/dm³] fb ≥ 8 [N/mm²]	~	
Brick No. 2	>		Brick-No. 9	- ac	
Solid sand-lime	116		Light-weight con-	X A D	
brick according to EN 771-2	E .		crete hollow block	8	8
ρ ≥ 1,8 [kg/dm³]			<b>Hbl</b> according to EN 771-1		8
fb ≥ 10 or 20	540		$\rho \ge 1.0 \text{ [kg/dm}^3\text{]}$	*	- 37 - 76
[N/mm²] Brick No. 3			fb ≥ 4 [N/mm²] Brick No. 10	~	
Solid sand-lime	16.2		Autoclaved	10	
brick according to	25		aerated concrete		
EN 771-2	63.		block	8	
ρ ≥ 1,8 [kg/dm³] fb ≥ 10 or 20	340		ρ ≥ 0,35, 0,5 or 0,65 [kg/dm³]		
[N/mm <sup>2</sup> ]			fb ≥ 2, 4 or 6	*	
544			[N/mm <sup>2</sup> ]		
Brick No. 4			Brick-No. 11		
Sand-lime hollow brick according to	175	1100	Solid brick Mz	2118	
EN 771-2	#3	2, 8, 0	according to EN 771-1		
$\rho \ge 1,4 [kg/dm^3]$	× 0	8; 1 OO	$\rho \ge 1.8  [kg/dm^3]$	\$ <sup>7</sup>	
fb ≥ 12 or 20 [N/mm²]	340	71 42	fb ≥ 10 or 20 [N/mm²]	2245	
[[V]]]	_		[M/HHH]		
Brick No. 5			Brick No. 12	\$ 12a	
Perforated brick HLz	116		Perforated brick		
according to EN 771-1	E. C.		HLz according to EN771-1	*	
$\rho \ge 0.9  [kg/dm^3]$		102 10	$\rho \ge 1.0  [kg/dm^3]$		2 12 22
$fb \ge 10 [N/mm^2]$	**		$fb \ge 4 \text{ or } 10 \text{ [N/mm}^2\text{]}$	255	→ 255
Brick No. 6		11	Brick No. 13	70	
Perforated brick HLz	\$50×	# 2020	Perforated brick		
according to	2		LLz according to	250	25, 38
EN 771-1 ρ ≥ 1,4 [kg/dm <sup>3</sup> ]	1	36.5	EN771-1 $\rho \ge 0.7 \text{ [kg/dm}^3\text{]}$	,	8 40 248
fb ≥ 20 [N/mm²]		14 - 8-	fb ≥ 2, 4 or 6	2,48	
		28	[N/mm <sup>2</sup> ]		
Brick No. 7 Perforated brick HLz	170 (240)	10 000000000			
according to	240		{		
EN 771-1			{		
$\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ [N/mm}^2\text{]}$	377		il S		
io ≥ 10 [iv/mm ]	(000)		_		
Imaging of the brid	cks are not scaled				
cher Injection sy	stem T-BOND F	RO.1 – FIS C	700 HP PRO.1		
,					

Table B5.1: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)2)</sup> and perforated or solid bricks

Kind of masonry	Brick	Valid anchor rods, internal threaded rods and perforated sleeves				
Brick No. 1 Solid brick Mz according to EN 771-1 $\rho \ge 1.8$ [kg/dm <sup>3</sup> ] fb $\ge 10$ or 20 [N/mm <sup>2</sup> ]	1,16		M8; M10; M12 FIS E 11x85 M6 FIS E 11x85 M8			
Brick No. 2 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20$ [N/mm <sup>2</sup> ]	118		M8; M10; M12 FIS E 11x85 M6 FIS E 11x85 M8			
Brick No. 3 Solid sand-lime brick according to EN 771-2 $\rho \ge 1.8$ [kg/dm <sup>3</sup> ] fb $\ge 10$ or 20 [N/mm <sup>2</sup> ]	SE S		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K			
Brick No. 4 Sand-lime hollow brick according to EN 771-2 $\rho \ge 1,4$ [kg/dm <sup>3</sup> ] fb $\ge 12$ or 20 [N/mm <sup>2</sup> ]	3.50		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K			
Brick No. 5 Perforated brick HLz according to EN 771-1 ρ≥ 0,9 [kg/dm³] fb≥ 10 [N/mm²]	113		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K			
Brick No. 6 Perforated brick HLz according to EN 771-1 $\rho \ge 1,4 \text{ [kg/dm}^3\text{]}$ fb $\ge 20 \text{ [N/mm}^2\text{]}$			FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K			

 $<sup>^{1)}</sup>$  Other combinations can be used after job site tests acc. to ETAG 029, Annex B.  $^{2)}$  Sleeve/anchor rod combination see table B1.3

The  $\beta\text{-}$  factor for this job site tests are given in Table C4 Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 1	Annex B 9

Table B5.2: Allocation of anchor rods<sup>1)</sup>, perforated sleeves<sup>1)2)</sup> and perforated or solid bricks

Kind of masonry	Brick	Valid anchor rods internal threaded rods and perforat sleeves		
Brick No. 7 Perforated brick HLz according to EN 771-1 $\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ [N/mm}^2\text{]}$			FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 20x130 K	
Brick No. 8 Perforated brick HLz filled with mineral wool acc. to EN 771-1 $\rho \ge 0.6 \text{ [kg/dm}^3\text{]}$ fb $\ge 8 \text{ [N/mm}^2\text{]}$			FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K FIS H 20x200 K	
Brick-No. 9 Light-weight concrete hollow block Hbl according to EN 771-1 $\rho \ge 1,0 \text{ [kg/dm}^3\text{]}$ fb $\ge 4 \text{ [N/mm}^2\text{]}$	92		FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS H 16x130 K FIS H 20x130 K	
Brick No. 10 Autoclaved aerat-ed concrete block $\rho \ge 0.35, 0.5 \text{ or } 0.65$ [kg/dm <sup>3</sup> ] fb $\ge 2, 4 \text{ or } 6 \text{ [N/mm}^2]$			M8; M10; M12 FIS E 11x85 M6 FIS E 11x85 M8 FIS E 15x85 M10 FIS E 15x85 M12	
Brick-No. 11 Solid brick Mz according to EN 771-1 $\rho \ge 1,8 \text{ [kg/dm}^3\text{]}$ fb $\ge 10 \text{ or } 20 \text{ [N/mm}^2\text{]}$	700		M8; M10; M12  FIS E 11x85 M6  FIS E 11x85 M8  FIS E 15x85 M10  FIS E 15x85 M12	
Brick No. 12 Perforated brick HLz according to EN771-1 ρ≥1,0 [kg/dm³] fb≥4 or 10 [N/mm²]			FIS H 12x85 K FIS H 16x85 K FIS H 20x85 K FIS E 11x85	
Brick No. 13 Perforated brick LLz according to EN771- 1 ρ≥0,7 [kg/dm³] fb≥2,4 or 6 [N/mm²]	248		FIS H 12x50 K	

<sup>1)</sup> Other combinations can be used after job site tests acc. to ETAG 029, Annex B.
2) Sleeve/anchor rod combination see table B1.3

The  $\beta\text{-}$  factor for this job site tests are given in Table C4 Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Intended Use Allocation of anchor rods, perforated sleeves and bricks, part 2	Annex B 10

Table C1.1: Characteristic values of resistance under tension loads and under shear loads

	Density ρ				Effective anchorage		Characteristic resistance [kN]	
Brick	[kg/dm <sup>3</sup> ]	Perforated	Anchor size or screw	depth		$N_{Rk}$		$V_{Rk}$
	Compressive strength f <sub>b</sub>	sleeve FIS HK	size in internal threaded anchor	h <sub>ef,min</sub>	h <sub>ef,max</sub>	Temp. 50/80°C		All
	[N/mm²]			[mm]	[mm]	d/d	w/w	categories
			M8	50	200	4,0	2,5	2,5
			M10	50	79	3,5	2,0	4,0
			M10	80	199	5,0	3,0	4,0
	ρ≥ 1,8		M10	200	200	8,5	7,5	8,5
	f <sub>b</sub> ≥ 10		M12	50	79	3,0	2,0	4,0
115			M12	80	199	5,5	3,5	4,0
F			M12	200	200	8,0	5,0	8,5
E			FIS E11x85 M6/ M8,	85	85	5,5	3,5	2,5
* 30		without	M8	50	200	5,5	3,5	4,0
No.1			M10	50	79	5,0	3,0	6.0
Solid brick Mz	ρ≥ 1,8 f <sub>b</sub> ≥ 20		M10	80	199	7,0	4,5	6,0
			M10	200	200	8,5	8,5	8,5
			M12	50	79	4,5	3,0	5,5
			M12	80	199	8,0	5,0	
			M12	200	200	8,5	7,0	8,5
			FIS E11x85 M6/ M8,	85	85	8,0	5,0	4,0
			M8	50	200	2,5		4,0
			M10	50	79		1,5	
			M10	80	199			4,0
	ρ≥ 1,8		M10	200	200	8,5	6,0	
. *	f <sub>b</sub> ≥ 10		M12	50	79	2,5	1,5	
116			M12	80	199			5,0
E 3			M12	200	200	8,5	6,5	
		without	FIS E11x85 M6/ M8,	85	85	2,5	1,5	3,0
240			M8	50	200	3,5		
No.2 Solid sand-lime			M10	50	79		2,0	5,5
Solia sana-ilme brick			M10	80	199			] 3,3
	ρ ≥ 1,8 f <sub>b</sub> ≥ 20		M10	200	200	8,5	8,5	
	., - 20		M12	50	79	3,5	2,0	7,0
			M12	80	199			
			M12	200	200	8,5	8,5	
			FIS E11x85 M6/ M8,	85	85	3,5	2,0	4,0

Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 1	Annex C 1

Table C1.2: Characteristic values of resistance under tension loads and under shear loads

	Density ρ	Lay Amonor ! Anchor!		I	ective orage	Char		tic resistance «N]
Brick	[kg/am*] -	Perforated screw size in	depth		$N_{Rk}$		$V_{Rk}$	
	Compressive strength f <sub>b</sub>	FIS HK	internal threaded anchor	h <sub>ef.min</sub>	h <sub>ef.max</sub>		np. 80°C	All
	[N/mm <sup>2</sup> ]			[mm]	[mm]	d/d	w/w	categories
		12x85	M8	85	85	6,0	3,5	3,0
		16x85	FIS E 11x85 M6	85	85	3,5	2,0	3,0
115.	ρ ≥ 1,8 f <sub>b</sub> ≥ 10	16x85	M8/M10, FIS E 11x85 M8	85	85	3,5	2,0	
EF		20x85	M12, FIS E 15x85	85	85	8,5	6,5	3,5
.3.		16x130	M8/M10	110	130	3,5	2,0	
30		20x130	M12	110	130	7,0	4,5	
	ρ≥ 1,8	12x85	M8	85	85	8,5	5,0	4,5
No.3 Solid sand-lime	f <sub>b</sub> ≥ 20	16x85	FIS E 11x85 M6	85	85	5,5	3,0	4,5
brick		16x85	M8/M10, FIS E 11x85 M8	85	85	5,5	3,0	
		20x85	M12, FIS E 15x85	85	85	8,5	8,5	5,5
		16x130	M8/M10	110	130	5,0	3,0	
		20x130	M12	110	130	8,5	6,0	
		12x85	M8	85	85	2,5	2,5	2,5
		16x85	FIS E 11x85 M6	85	85	3,0	2,5	2,5
	ρ≥1,4 f <sub>b</sub> ≥12	16x85	M8/M10, FIS E 11x85 M8	85	85	3,0	2,5	4,5
118		20x85	M12, FIS E 15x85	85	85			
288		16x130	M8/M10	110	130	3,5	3,0	4,5
		20x130	M12	110	130			
240		12x85	M8	85	85	4,5	4,0	4,5
No.4 Sand-lime hollow brick		16x85	FIS E 11x85 M6	85	85	5,0	4,0	4,0
	ρ≥1,4 f <sub>b</sub> ≥20	16x85	M8/M10, FIS E 11x85 M8	85	85	5,0	4,5	7,5
		20x85	M12, FIS E 15x85	85	85			
		16x130	M8/M10	110	130	6,0	5,5	7,5
		20x130	M12	110	130			

Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 2	Annex C 2

Table C1.3: Characteristic values of resistance under tension loads and under shear loads

	Density p		Anchor size or	Effec anchorag				stic resistance [kN]
B	[kg/dm <sup>3</sup> ]	Perforated	screw size in		'	N <sub>Rk</sub>		V <sub>Rk</sub>
Brick	Compressive strength fb	sleeve FIS HK	internal threaded anchor	h <sub>ef,min</sub>	h <sub>ef,max</sub>		mp. 30°C	All
	[N/mm²]			[mm]	[mm]	d/d	w/w	categories
176		12x85	M8	85	85	4,0	3,5	4,0
Et Constitution of the con		16x85	FIS E 11x85 M6	85	85	3,5	3,5	4,0
	ρ≥ 0,9	16x85	M8/M10, FIS E 11x85 M8	85	85	3,5	3,5	5,5
40	f <sub>b</sub> ≥ 10	20x85	M12, FIS E 15x85	85	85	5,0	4,5	6,0
No.5 Perforated brick		16x130	M8/M10	110	130	5,0	4,5	5,5
		20x130	M12	110	130	5,0	4,5	6,0
		12x85	M8	85	85	4,0	3,5	7,5 (5,5) <sup>1)</sup>
2 1000	->14	16x85	FIS E 11x85 M6	85	85	2	,5	4,0
	$\rho \ge 1.4$ $f_b \ge 20$	16x85	M8/M10, FIS E 11x85 M8	85	85	2	,5	4,5
No.6 Perforated brick		20x85	M12, FIS E 15x85	85	85	3,0		8,5 (5,5) <sup>1)</sup>
Te Swal	ρ≥ 1,0 f <sub>b</sub> ≥ 10	12x85	M8	85	85	0,9 2,5		
540		16x85	M8/M10, FIS E 11x85	85	85			1,2
		20x85	M12, FIS E 15x85	85	85			
23 (80)		16x130	M8/M10	110	130			1,5
No.7 Perforated brick		20x130	M12	110	130	3,5	3,0	1,5
370		12x85	M8	85	85	2,0	2,0	2,5
1 2 4 4		16x85	FIS E 11x85 M6	85	85	2,0	1,5	2,5
	ρ≥ 0,6	16x85	M8/M10, FIS E 11x85 M8	85	85	2,0	1,5	3,0
- 30	f <sub>b</sub> ≥ 8	20x85	M12, FIS E 15x85	85	85	2,0	2,0	1,5
N- OD- (		16x130	M8/M10	110	130	3,0	2,5	3,0
No.8 Perforated brick		20x130	M12	110	130	2,0	2,0	1,5
		20x200	M12	180	200	3,0	3,0	1,5
249		12x85	M8	85	85			
9		16x85	M8/M10, FIS E 11x85	85	85	3,0 2,0		
	ρ≥1,0 f>4	20x85	M12, FIS E 15x85	85	85			2,0
*	f <sub>b</sub> ≥ 4	16x130	M8/M10	110	130			
No.9 Light-weight concrete hollow block		20x130	M12	110	130			

 $<sup>^{1)}</sup>$  Characteristic value of pushing out of one brick  $V_{\text{Rk},\text{pb}}\!=5.5$  kN Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 3	Annex C 3

Table C1.4: Characteristic values of resistance under tension loads and under shear loads

		Anchor size or		anch	Effective anchorage depth			ic resistance N]	
Brick	Density p	Perforated	screw size in			N	Rk	$V_{Rk}$	
BHOK	Density ρ [kg/dm³] -	sleeve FIS HK	internal threaded anchor				mp. 80°C	All	
	Compressive strength f <sub>b</sub> [N/mm <sup>2</sup> ]			h <sub>ef,min</sub> [mm]	h <sub>ef,max</sub> [mm]	d/d	w/w	categories	
360			M8	100	120			1,2	
	ρ≥0,35 f <sub>b</sub> ≥2	without	M10	100	120	1,5		1,2	
280			M12	100	120			1,5	
***			FIS E 11x85 FIS E 15x85	8	5			1,2	
			M8	100	120	2	,0	2,5	
No.10 Autoclaved	ρ≥ 0,5		M10	100	120	2,5		2,0	
Aerated concrete block	$p \ge 0.5$ $f_b \ge 4$	without	M12	100	120			2,5	
	-		FIS E 11x85 FIS E 15x85	8	5	2,0		2,0	
			M8	100	120	3,5	3,0	3,0	
	ρ≥ 0,65		M10	100	120	5,0	4,5	3,0	
	$f_b \ge 6$	without	M12	100	120	3,0	4,5	3,5	
			FIS E 11x85 FIS E 15x85	8	5	3	,5	2,5	

Imaging of the bricks are not scaled

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 4	Annex C 4

Table C1.5: Characteristic values of resistance under tension loads and under shear loads

Brick	Density p [kg/dm³]	Perforated	Anchor size or		ctive orage oth	Charac	cteristic [kN]	resistance
DIICK	-	sleeve	internal threaded			N	Rk	$V_{Rk}$
	Compressive strength f <sub>b</sub>	FIS HK	anchor	h <sub>ef,min</sub>	h <sub>ef,max</sub>	Temp.	50/80°C	All
	[N/mm <sup>2</sup> ]			[mm]	[mm]	d/d	w/w	categories
			M8	50	100	1,5	0,9	3,0
			FIS E 11x85 M6	85	85	1,2	0,6	2,0
\$118	ρ≥ 1,8	without	FIS E 11x85 M8	85	85	1,2	0,75	3,0
4	f <sub>b</sub> ≥ 10	Without	FIS E 15x85 M10/M12	85	85	1,2	0,75	4,0
>54			M10	50	100	1,2	0,75	4,0
22)45			M12	50	100	1,2	0,75	4,5
Zlin	ρ ≥ 1,8 f <sub>b</sub> ≥ 20	without	M8	50	100	2,5	1,5	4,0
~			FIS E 11x85 M6	85	85	1,5	0,9	2,5
			FIS E 11x85 M8	85	85	2,0	1,2	4,0
Nr.11: Solid brick Mz			FIS E 15x85 M10/M12	85	85	2,0	1,2	5,5
			M10	50	100	2,0	1,2	5,5
			M12	50	100	2,0	1,2	5,5
_		12x85	M8	85	85	1,2	0,9	1,5
120		16x85	M8/M10	85	85	1,2	0,9	2,0
	ρ≥ 1,0	16x85	FIS E 11x85 M6/M8	85	85	1,2	0,9	2,0
£	f <sub>b</sub> ≥ 4	20x85	M12	85	85	0,5	0,5	2,0
		20x85	FIS E 15x85 M10/M12	85	85	0,5	0,5	2,0
255		12x85	M8	85	85	2,5	2,5	3,5
		16x85	M8/M10	85	85	2,5	2,5	4,5
Nr.12: Perforated brick	ρ≥ 1,0	16x85	FIS E 11x85 M6/M8	85	85	2,5	2,5	4,5
HLz	f <sub>b</sub> ≥ 10	20x85	M12	85	85	1,2	1,2	4,5
		20x85	FIS E 15x85 M10/M12	85	85	1,2	1,2	4,5

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 5	Annex C 5

Table C1.6: Characteristic values of resistance under tension loads and under shear loads

Defal	Density p [kg/dm³]	Perforated	Anchor size or screw size in	anch	ctive orage pth	Charac	teristic re	sistance [kN]
Brick	Compressive	sleeve FIS HK	internal threaded anchor				I <sub>Rk</sub>	V <sub>Rk</sub>
	strength f <sub>b</sub>		anchor	h <sub>ef,min</sub>	h <sub>ef,max</sub>	Temp.	50/80°C	All
	[N/mm²]			[mm]	[mm]	d/d	w/w	categories
	$ \rho \ge 0.7 \\ f_b \ge 2 $	12x50	M8	50	50	0,6	0,5	0,5
248	$ \rho \ge 0.7 \\ f_b \ge 4 $	12x50	M8	50	50	1,2	0,9	0,9
Nr.13: Perforated brick LLz	$\rho \ge 0.7$ $f_b \ge 6$	12x50	M8	50	50	1,5	1,5	1,5

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic values of resistance under tension loads and under shear loads, part 6	Annex C 6

Table C2: Characteristic bending moments for threaded rods

Size	,				M8	M10	M12
		Zinc-plated steel	Property class	5.8 [Nm]	19	37	65
g		Zinc-plated steel	Property class	8.8 [Nm]	30	60	105
bending Ik,s	Stainless steel A4	Proporty class	50 [Nm]	19	37	65	
þe	$M_{Rk,s}$	Stailliess steel A4	Property class	70 [Nm]	26	52	92
stic	Σ			80 [Nm]	30	60	105
teri	=			50 [Nm]	19	37	65
		High corrosion-resistant steel C	Property class	70 <sup>1)</sup> [Nm]	26	52	92
S	2			80 [Nm]	30	60	105

 $<sup>^{1)}</sup> f_{uk} = 700 \text{ N/mm}^2; f_{yk} = 560 \text{ N/mm}^2$ 

Table C2.1: Characteristic bending moments for internal threaded anchors FIS E

Size FIS E				11x85 M6	11x85 M8	15x85 M10	15x85 M12
	zinc	Property	5.8 [Nm]	8	19	37	65
bending A <sub>Rk,s</sub>	plated steel,	class of screw	8.8 [Nm]	12	30	60	105
eristic b nents M	stainless steel A4	Property class of screw	70 [Nm]	11	26	52	92
Characteristic bend moments M <sub>Rk,s</sub>	high corrosion resistant steel C	Property class of screw	70 [Nm]	11	26	52	92

Tabelle C3: Displacements under tension loads and shear loads

Material	N [kN]	δN <sub>0</sub> [mm]	δN∞ [mm]	V [kN]	δV <sub>0</sub> [mm]	δV∞ [mm]
solid units and autoclaved aerated concrete	N <sub>Rk</sub>	0,03	0,06	V <sub>Rk</sub>	0,59	0,88
hollow units	N <sub>Rk</sub> 0,03		0,06	V <sub>Rk</sub>	1,71	2,56

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Characteristic bending moments; displacements	Annex C 7

Table C4:  $\beta$ - factor for job site tests according to ETAG 029, Annex B

Using categories	w/w	d/d			
Temperature range	50/80	50/80			
Brick					
	M8	0,57			
Solid brick	M10	0,59	0,96		
	M12 FIS E 11x85 FIS E 15x85	0,60			
Hollow brick	All sizes	0,86	0,96		
Autoclaved aerated concrete	All size	0,73	0,81		


fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances β- factors for job site tests	Annex C 8

Table C5: Edge distance and spacing

Direction to bed joint		Ţ				Group factor				Min. thickness				
Brick No.	h <sub>ef</sub>	C <sub>cr</sub> =C <sub>min</sub>	S <sub>min</sub>	S <sub>cr</sub>	S <sub>min</sub>	S <sub>cr</sub>	1				т		of the masonry members	
BIICK NO.	[mm]	[mm]	[mm]	[mm]	[mm]	[mm]	$\alpha_{\text{g,N}}$	$\alpha_{g,N}$ $\alpha_{g,V}$		$\alpha_{g,V}$	[mm]			
	50	100	7	5	60 <sup>1)</sup>	150	2	2	1,5	1,4				
1	80	100	7	5	60 <sup>1)</sup>	240	2 2 1,5 1,4							
	200	150	7	5	2	40				2				
	50	100	7	5	2	40			2					
2	80	100	7	5	2	40								
	200	150	7	5	2	40								
3	85	100	11			40				2 2				
	130	100	11		_	40								
4	all sizes	100	11		100 240		2	2	1,5 1,5					
5	all sizes	100	11		240		2							
6	all sizes	100	11	15	240		2							
7	all sizes	100	100	240	100	$100 \begin{vmatrix} 375 \\ (500)^{2} \end{vmatrix}$		1	1	1	h <sub>ef</sub> + 30 (≥ 80)			
8	all sizes	120	24	<b>1</b> 5	2	50	2			(= 55)				
9	all sizes	80	24	10	3	65		2		2			]	
10	all sizes	100	25	50	2	50			2					
	50													
11	100	60	60		245		2							
	85													
10	50	60	1,	20	255		2							
12	85	60	12	20	2	55 	2							
13	50	100	25	50	75	250	2,0	2,0 2,0 1,6 1,1						

 $<sup>^{1)}</sup>$  only valid for tension loads, for shear loads  $s_{min} \big\| = s_{cr} \big\|$  spacing depending on brick dimension, brick dimension see table B4, brick 7

fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1	
Performances Edge distance and spacing	Annex C 9

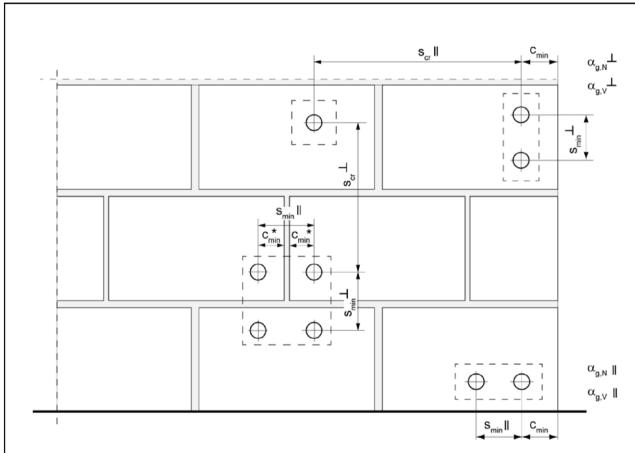

\* Only, if joints are visible and vertical joints are not filled with mortar

 $s_{min} II = Minimum spacing parallel to bed joint$ 

 $s_{min}^{\perp}$  = Minimum spacing vertical to bed joint

s<sub>cr</sub> II = Characteristic spacing parallel to bed joint

 $s_{cr}^{\perp}$  = Characteristic spacing vertical to bed joint

 $c_{cr} = c_{min}$  = Edge distance

 $\alpha_{q,N}$  II = Group factor for tension load parallel to bed joint

 $\alpha_{q,V}$  II = Group factor for shear load parallel to bed joint

 $\alpha_{a,N} \perp$  = Group factor for tension load vertical to bed joint

 $\alpha_{a,V} \perp$  = Group factor for shear load vertical to bed joint

For 
$$s > s_{cr}$$
  $\alpha_g = 2$ 

For 
$$s_{min} \le s \le s_{cr}$$
  $\alpha_{q}$  according to table C5

For 
$$s_{\text{min}} \le s \le s_{\text{cr}}$$
  $\alpha_g$  according to table C5  $N_{\text{Rk}}^g = \alpha_{g,N} \cdot N_{\text{Rk}}; \quad V_{\text{Rk}}^g = \alpha_{g,V} \cdot V_{\text{Rk}}$  (Group of 2 anchors)  $N_{\text{Rk}}^g = \alpha_{g,N} \coprod \bullet N_{\text{Rk}}; \quad V_{\text{Rk}}^g = \alpha_{g,V} \coprod \bullet N_{\text{Rk}}; \quad V_{\text{Rk}}^g = \alpha_{g,V} \coprod \bullet N_{\text{Rk}}$  (Group of 4 anchors)

$$N_{Rk} = \alpha_{g,N} \parallel \cdot \alpha_{g,N} + N_{Rk}$$
;  $V_{Rk} = \alpha_{g,V} \parallel \cdot \alpha_{g,V} + V_{Rk}$  (Group of 4 anchors

### fischer Injection system T-BOND PRO.1 – FIS C700 HP PRO.1

#### **Performances**

Definition of minimum edge distance, minimum spacing and group factors

Annex C 10